



Flint Water Incident - Residential Water Sampling Results - Lead

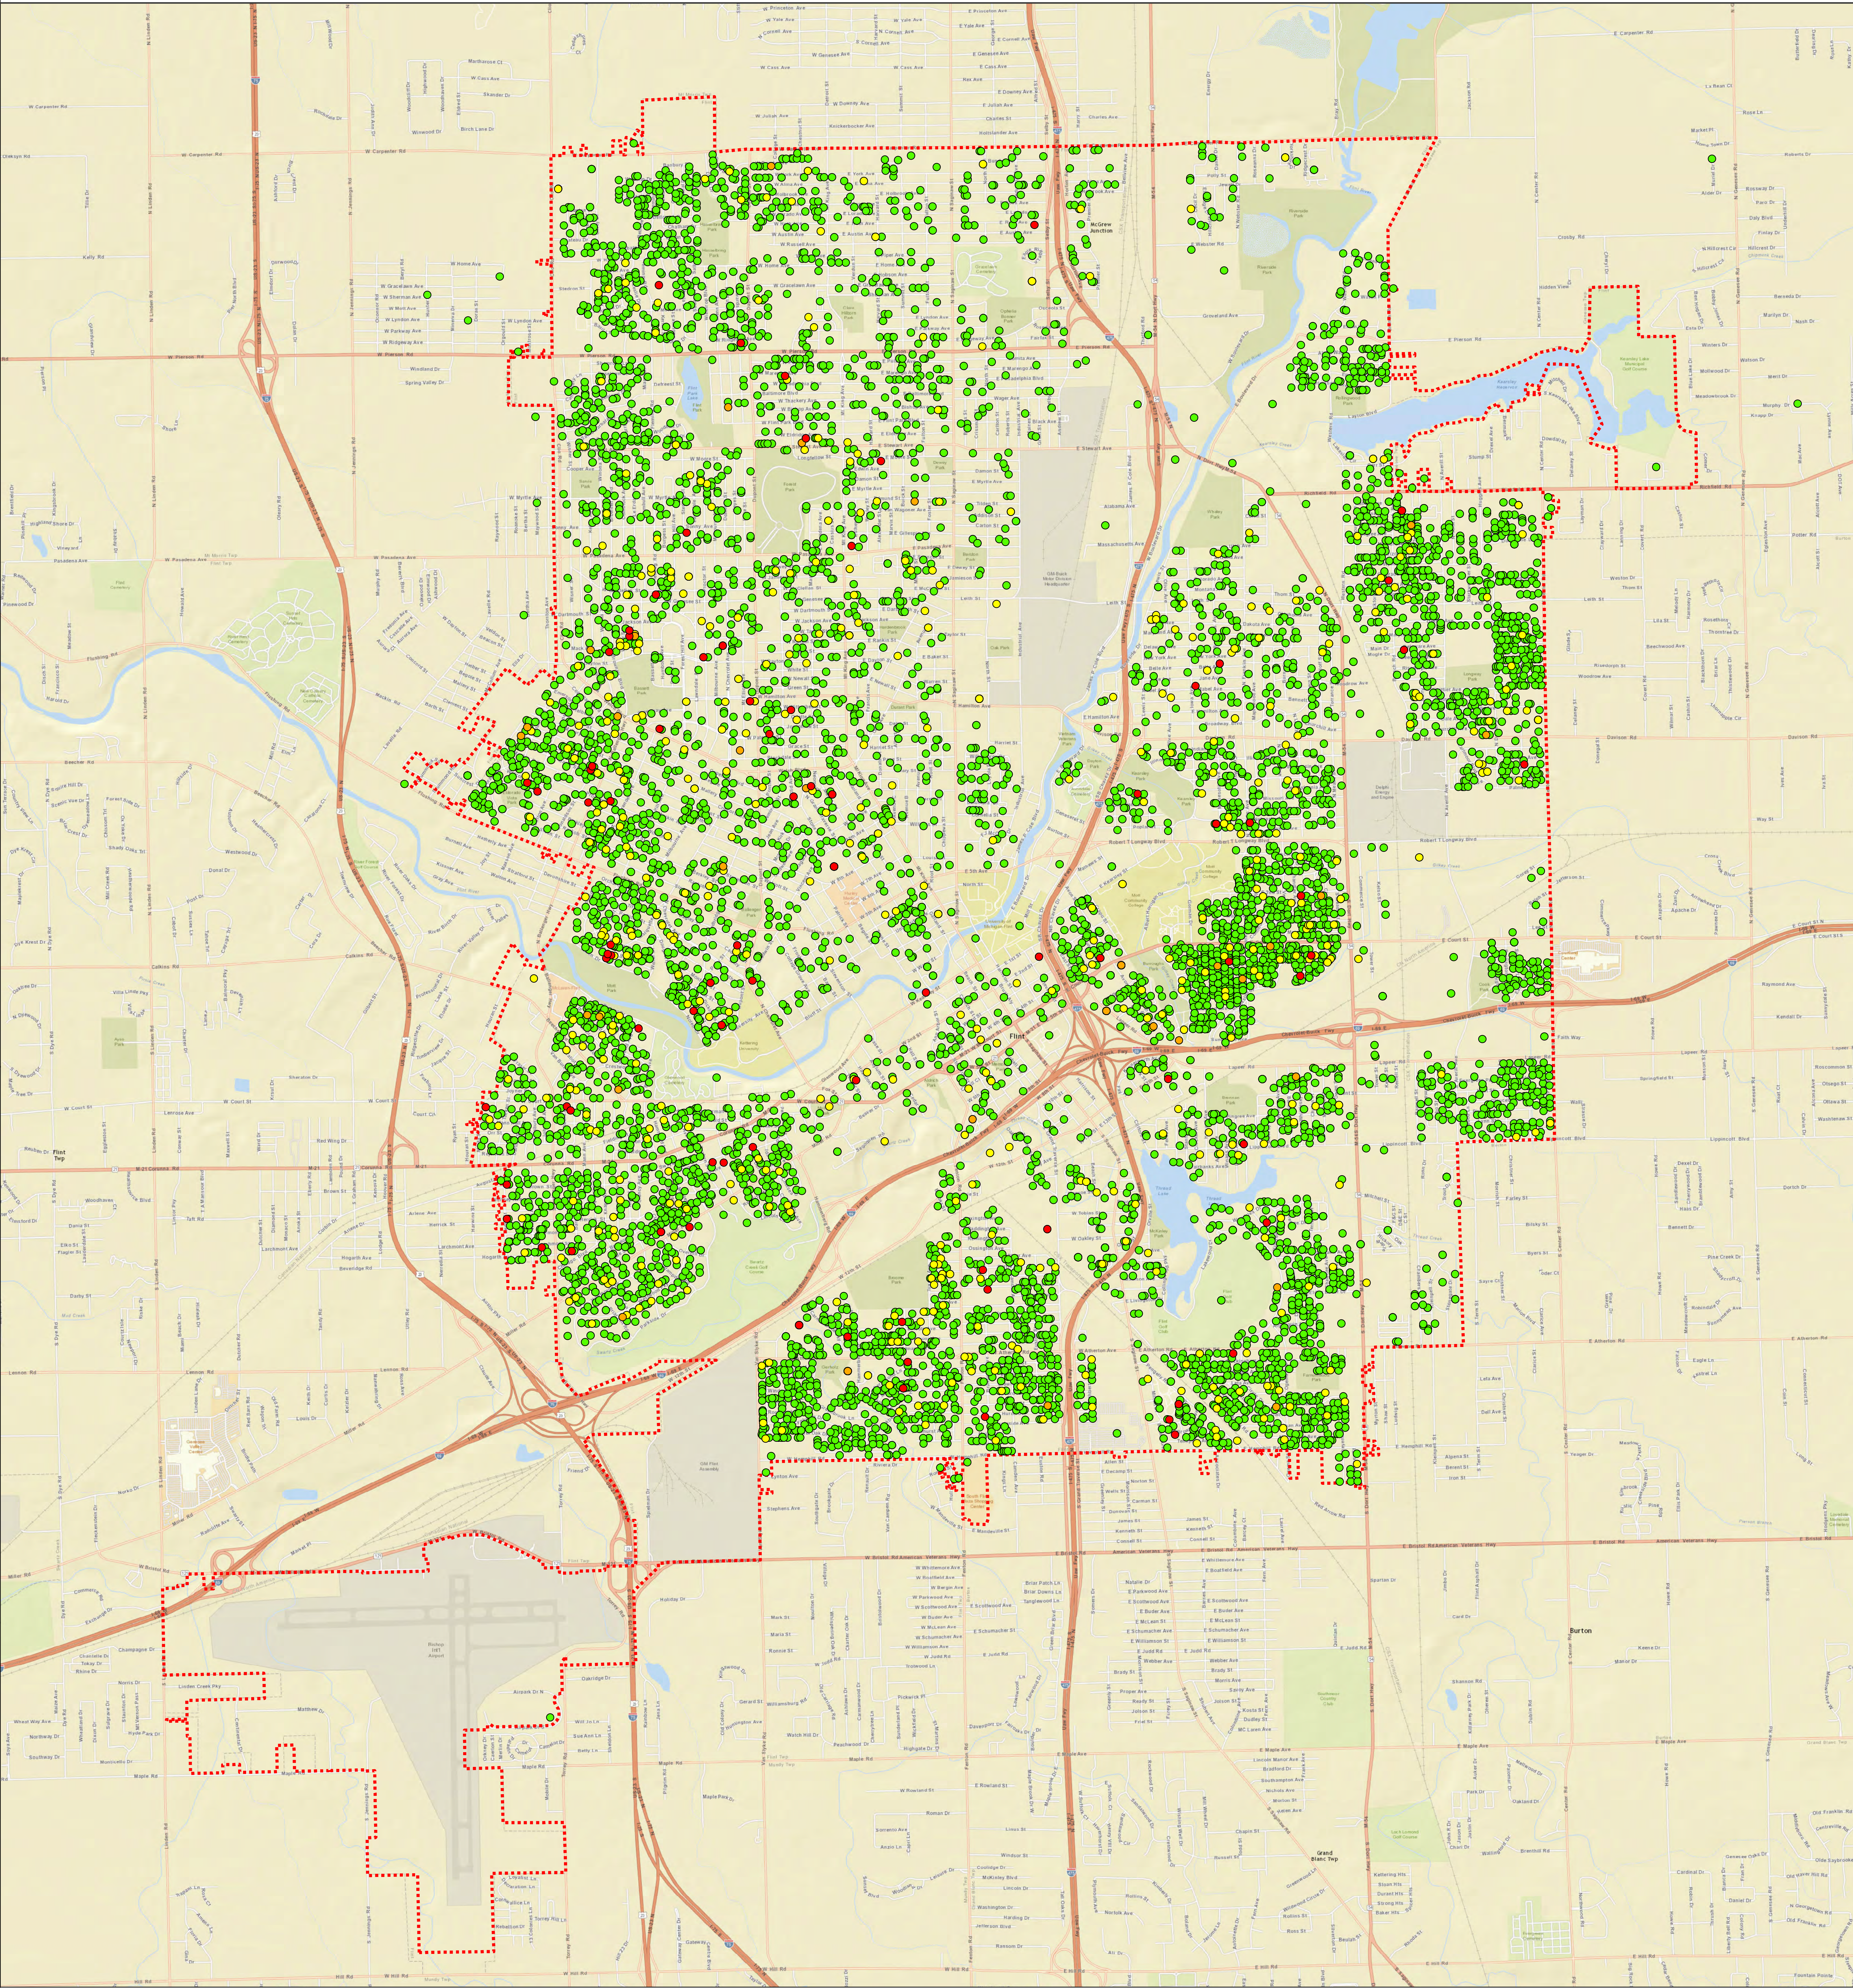


Legend

- 9,619 Sample Results <16 ppb (In compliance with LCR; continue filter use & maintenance) 92.9%
 - 605 Sample Results from 16-100 ppb (Above LCR; continue filter use & maintenance; additional documentation sent to residents) 5.9%
 - 36 Sample Results from 101-149 ppb (Above LCR; continue filter use and maintenance; triggers water home visits within 7 days) .3%
 - 91 Sample Results >150 ppb (Above the Rating for filters; triggers health home visits within 48 hours) .9%
- Flint w/Franchise Boundary

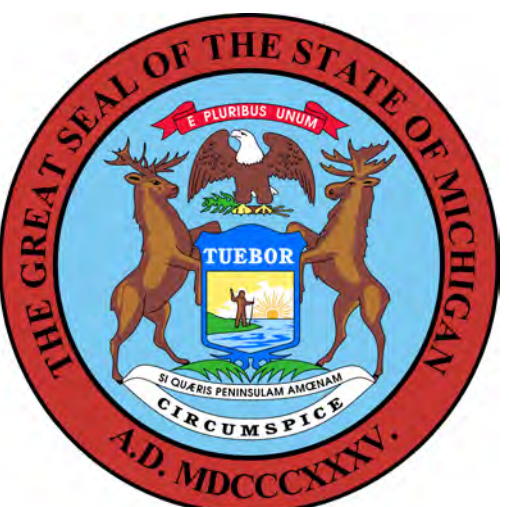

State of Michigan

Date: 02/19/2016

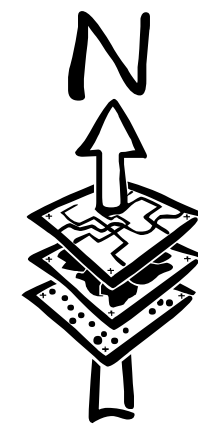

1 0.5 0 1 Miles